

**DECK GUARDRAIL DESIGN NOTES:**  
 GUARDRAIL DESIGN LOAD SHALL WITHSTAND 200 POUNDS CONCENTRATED LOAD APPLIED IN ANY DIRECTION AT ANY POINT ALONG THE TOP OF THE GUARD, & 50 PSF AT THE INFILL COMPONENTS OF THE GUARD

**FRAMING NOTE CONT.**  
 ALL HEADERS & BEAMS SHALL BE #1 S.Y.P. U.N.

**FRAMING NOTE:**  
 TRUSS ENGINEERING DRAWINGS TO BE ON SITE FOR FRAMING INSPECTION

OVERFRAMED ATTIC AREAS TO BE OPEN TO MAIN ATTIC FOR VENTILATION & ACCESS

42'-8" TRUSS BEARING  
 7'-0" (2) 2X10  
 BY MANUFACTURER @ 16" O.C.  
 ENGINEERED ATTIC ROOF TRUSSES



3 1/2" STEEL POST W/  
 4 1/2" W X 12 L • BASE PLATE  
 W/(2) 1/2" HOLES FOR FDN ANCHORS  
 (RED HEAD 1/2" X 4 1/4" WEDGE ANCHOR)  
 6" W X 3 1/2" L • POST CAP  
 FOR GIRDER TRUSSES  
 (3) 2X10 BOTTOM CHORDS

**DRIVEWAY NOTE:**  
 MIN. GRADE @ 1%  
 MAX. GRADE @ 15%

(2) 1 3/4" X 11 7/8" LVL  
 (CONTINUOUS FOR WALL BRACING)  
 6X6 P.T. POST ANCHORED TO SLAB  
 W/SIMPSON ABAG6Z POST BASE  
 OR PPB66-4Z PORCH POST BASE  
 W/SIMPSON BC46Z POST CAP  
 DECORATIVE TAPERED COLUMN  
 ON DECORATIVE WOOD BASE  
 WRAPPED W/ CULTURED STONE

**REVISIONS:**

Job Request	10/21/25
Design Dev-1	11/15/25
Design Dev-2	11/28/25
Permit Release	11/28/25
Permit Rev-1	01/27/26
Permit Rev-2	02/22/26

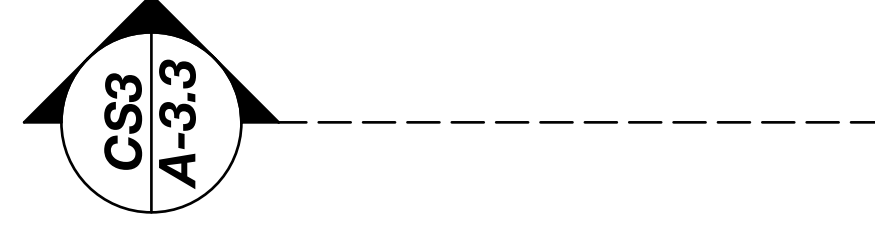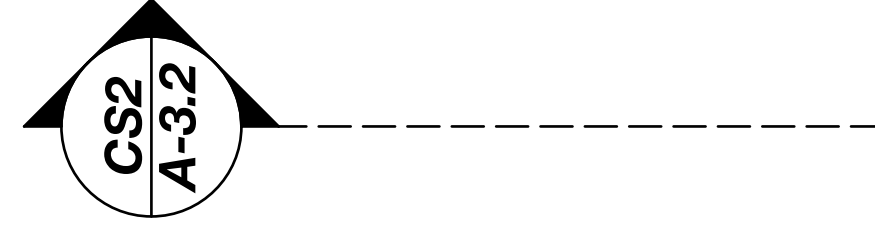

**FRAMING NOTE:**  
TRUSS ENGINEERING  
DRAWINGS TO BE ON  
SITE FOR FRAMING  
INSPECTION

